

ADA Curb Ramp New Construction Inspection Form (Blended Transition)

Project Name (Section)

Construction Contract No. Highway No.
Year

MP Cross Street Name


Calibration Date

(mm/dd/yy)

See Exhibit A for more corner styles

Ramp Style

RAMP RUN 1	Pass	Fail	DE
Running Slope 1			
Cross Slope 1	≤ 2.0%	> 2.0%	
Detectable Warning	(TD, X)	(N, IITD, DMG TD)	
Lip Height	0"	> 0"	
Gutter Flow Slope	≤ *	> *	
Curb Running Slope (avg)	≤ *1	> *1	
Counter Slope (+/-) ^{N/A}	≤ 5.0%	> 5.0%	

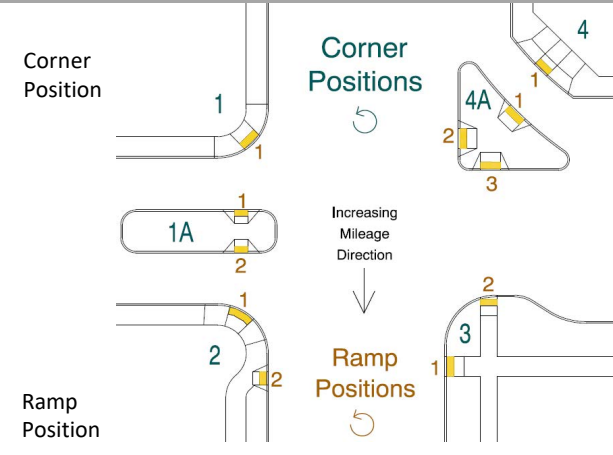


DIRECTIONAL CURB	Pass	Fail	DE
Direct. Curb Running Slope	≤ 4.9%	> 4.9%	
Direct. Curb Cross Slope	≤ *	> *	
<p>*The passing value for Gutter Flow Slope (GFS) and Directional Curb Cross Slope depend on the Intersection Condition Type. At a Midblock (MB), slopes must be ≤ Slope of the Road, at Signalized or Uncontrolled (SU), slopes must be ≤ 5.0%, and at Stop or Yield (SY), slopes must be ≤ 2.0%.</p> <p>*1 CRS must be ≤ 4.9% when there is a Directional curb present, else ≤ 8.3%</p> <p>NOTE: Blended Transitions are locations where the pedestrian walkway (which has one direction of travel) and the street crossing intersect at the same plane without the need of a ramp. If the Running Slope is 5.0% not a Blended Transition and should be inspected using a different inspection form.</p>			

Physical Condition (G,P)		Functional Condition (G,P)	
Fail	DE	Fail	DE
CRK		ICRR	
DO		INLET XING	
GB		STR	
		FT BT DR	

Comment: *See also Standard Comments for full list of acceptable comments*

See also Standard Drawings to assess provisions not shown: (inlets, alignment, etc.)

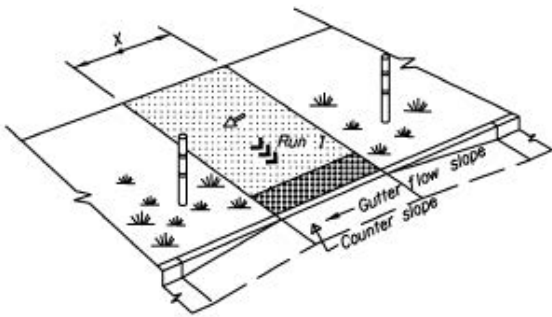

BLENDING TRANSITION (BT)

- Pedestrian access route (To measure clear width)
- Detectable warning surface
- Cross slope (2.0% finish grade max.)
- Running slope (<5.0% finish grade max.) (If running slope ≥5.0%, this is a curb ramp, not a blended transition.)
- Counter slope (5.0% finish grade max.)
- Gutter flow slope (as required)
- Edge of Gutter Pan

MISCELLANEOUS Traversable	Pass	Fail	DE
Flare Slope 1	≤ 10%	> 10%	
Flare Slope 2	≤ 10%	> 10%	
Clear Width (feet)	≥ 4.0'	< 4.0'	
Intersection Condition Type	Slope of Road		
Design Ex. Control Number			

Inspector's Signature _____ Date (mm/dd/yy) _____

Print name clearly _____ Certification No. _____

Company/Agency _____ Crew No. (ODOT) _____



ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed