



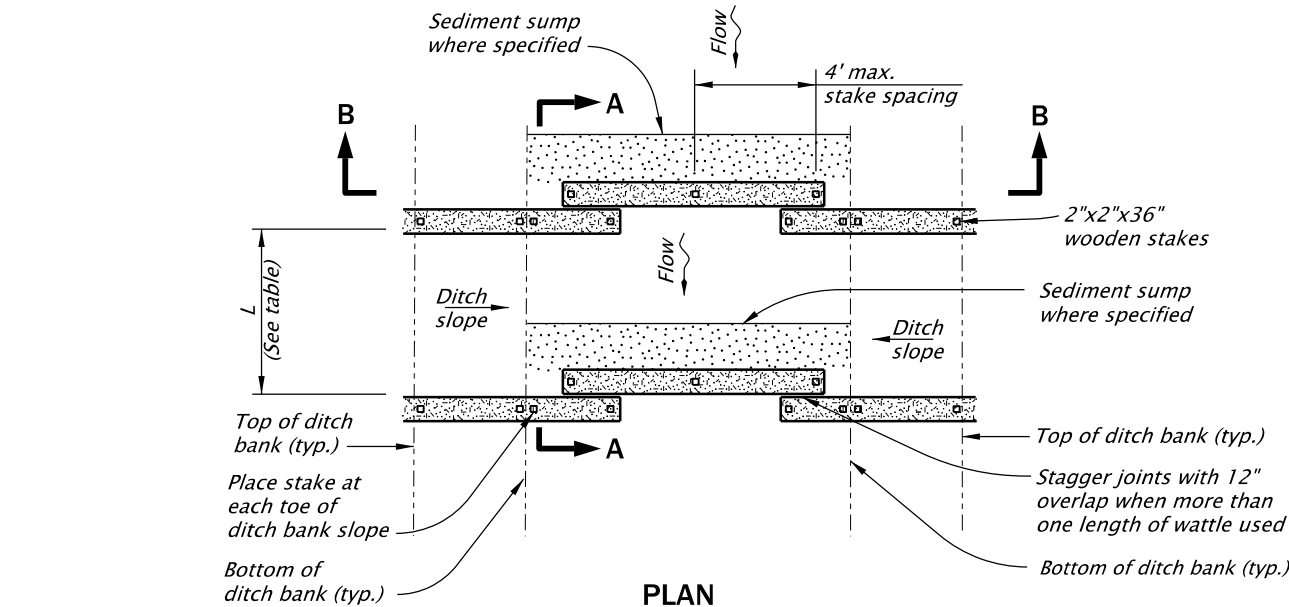


PLAN

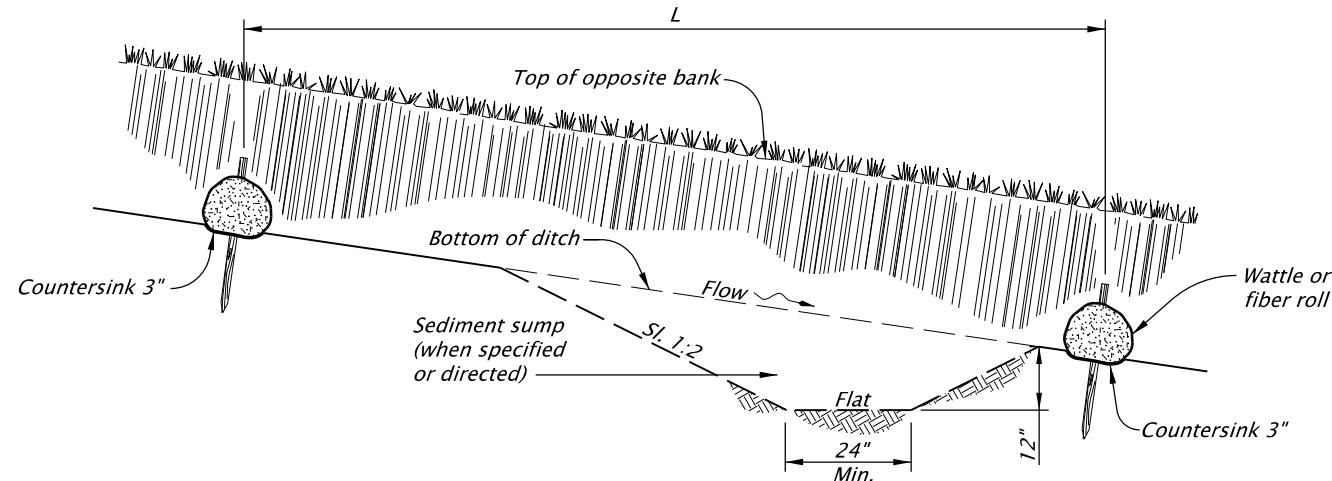


SECTION A-A

WATTLE / FIBER ROLL CHECK DAM - TYPE 2

NOT TO SCALE

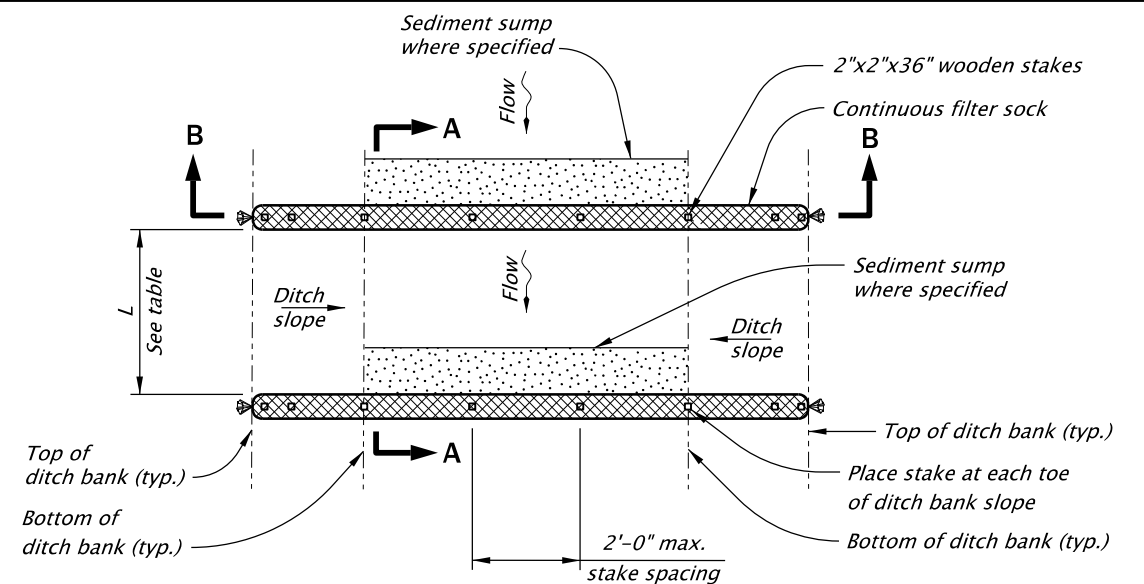

PLAN

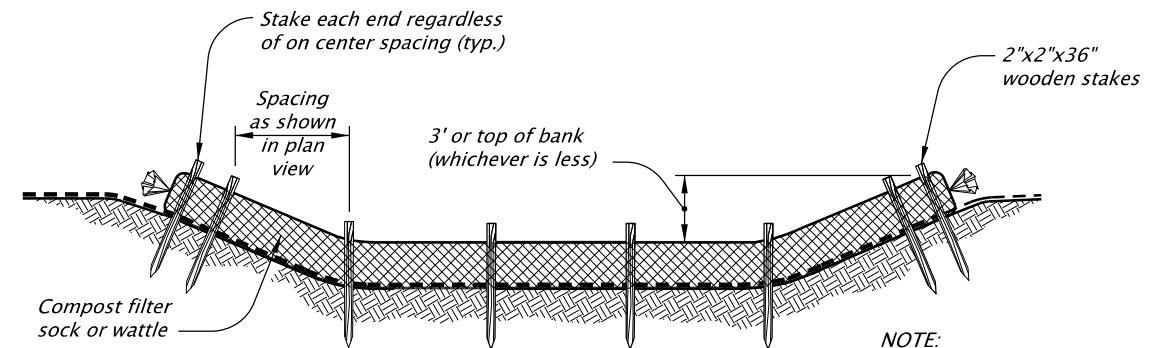


SECTION B-B


COMPOST FILTER SOCK CHECK DAM - TYPE 6

NOT TO SCALE

NOTE:
Fully biodegradable compost socks are suitable for permanent installation only. Product becomes too fragile to be moved or removed intact.

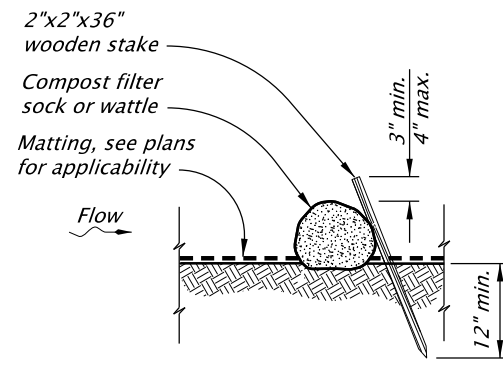

ALTERNATIVE 1

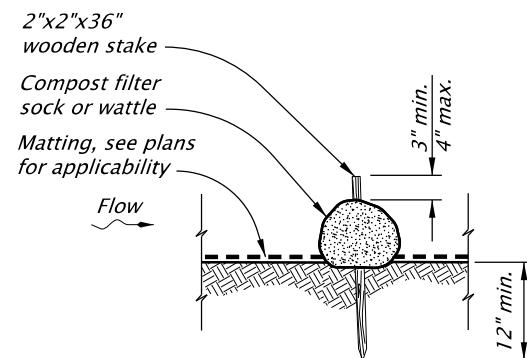

ALTERNATIVE 2

FIBER ROLL AND COMPOST SOCK STAKING ALTERNATIVES

NOT TO SCALE

MAXIMUM CHECK DAM SPACING "L"

Ditch Grade	H=8"	H=12"	H=18"	H=24"
10%	**	**	15'	20'
9%	**	**	16'	22'
8%	**	**	18'	25'
7%	**	**	21'	28'
6%	**	16'	25'	33'
5%	**	20'	30'	40'
4%	16'	25'	37'	50'
3%	22'	33'	50'	66'
2%	33'	50'	75'	100'

** Not allowed

H = Min. dam height

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.

OREGON STANDARD DRAWINGS

CHECK DAMS
TYPE 2 AND 6

2024

DATE	REVISION	DESCRIPTION
01-2021	REMOVED	CALC BOOK NUMBERS
CALC. BOOK NO.	N/A	SDR DATE: 20-JAN-2021

RD1006

Effective Date: June 1, 2026 – November 30, 2026