


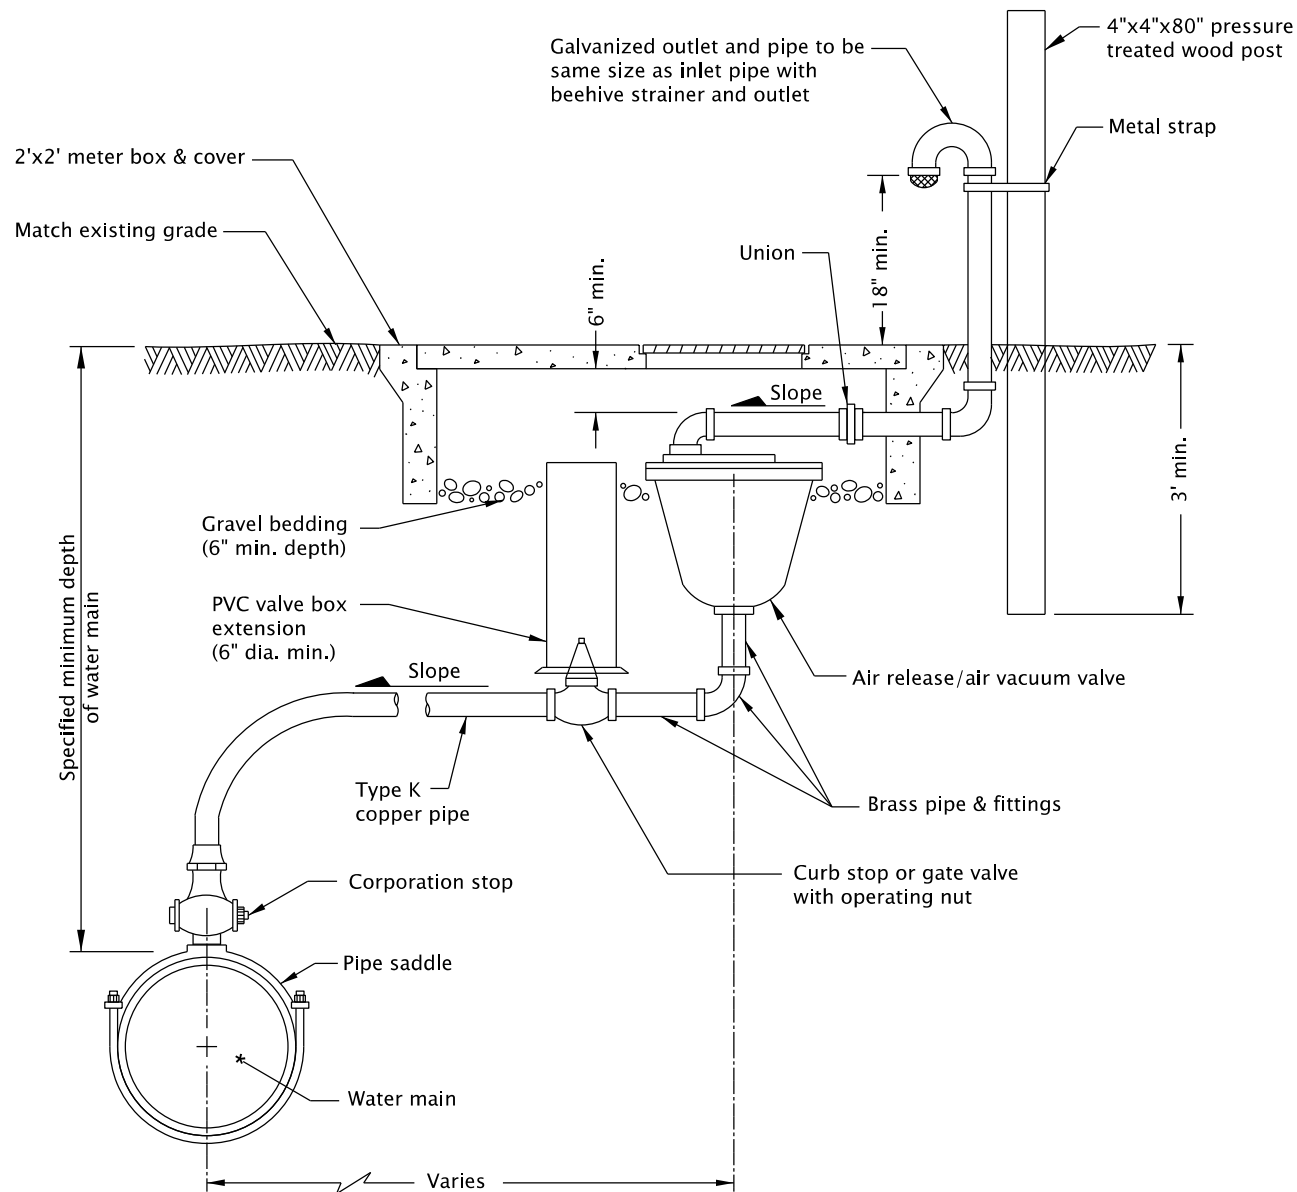

GENERAL NOTES FOR ALL DETAILS ON THIS SHEET:

1. Air release/air vacuum valve shall be size specified in Contract.
Piping and valves to be same size as combination air release/air vacuum valve.
2. Locate at high point of main.
3. Tap top of main.
4. Provide insulation and additional depth when specified for freeze protection.
5. See project plans for details not shown.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.

OREGON STANDARD DRAWINGS
COMBINATION AIR RELEASE
AIR VACUUM VALVE ASSEMBLY
(2" AND SMALLER)

2024

DATE	REVISION	DESCRIPTION

CALC. BOOK NO. . . . N/A SDR DATE- 25-JUL-2017 -

RD270