


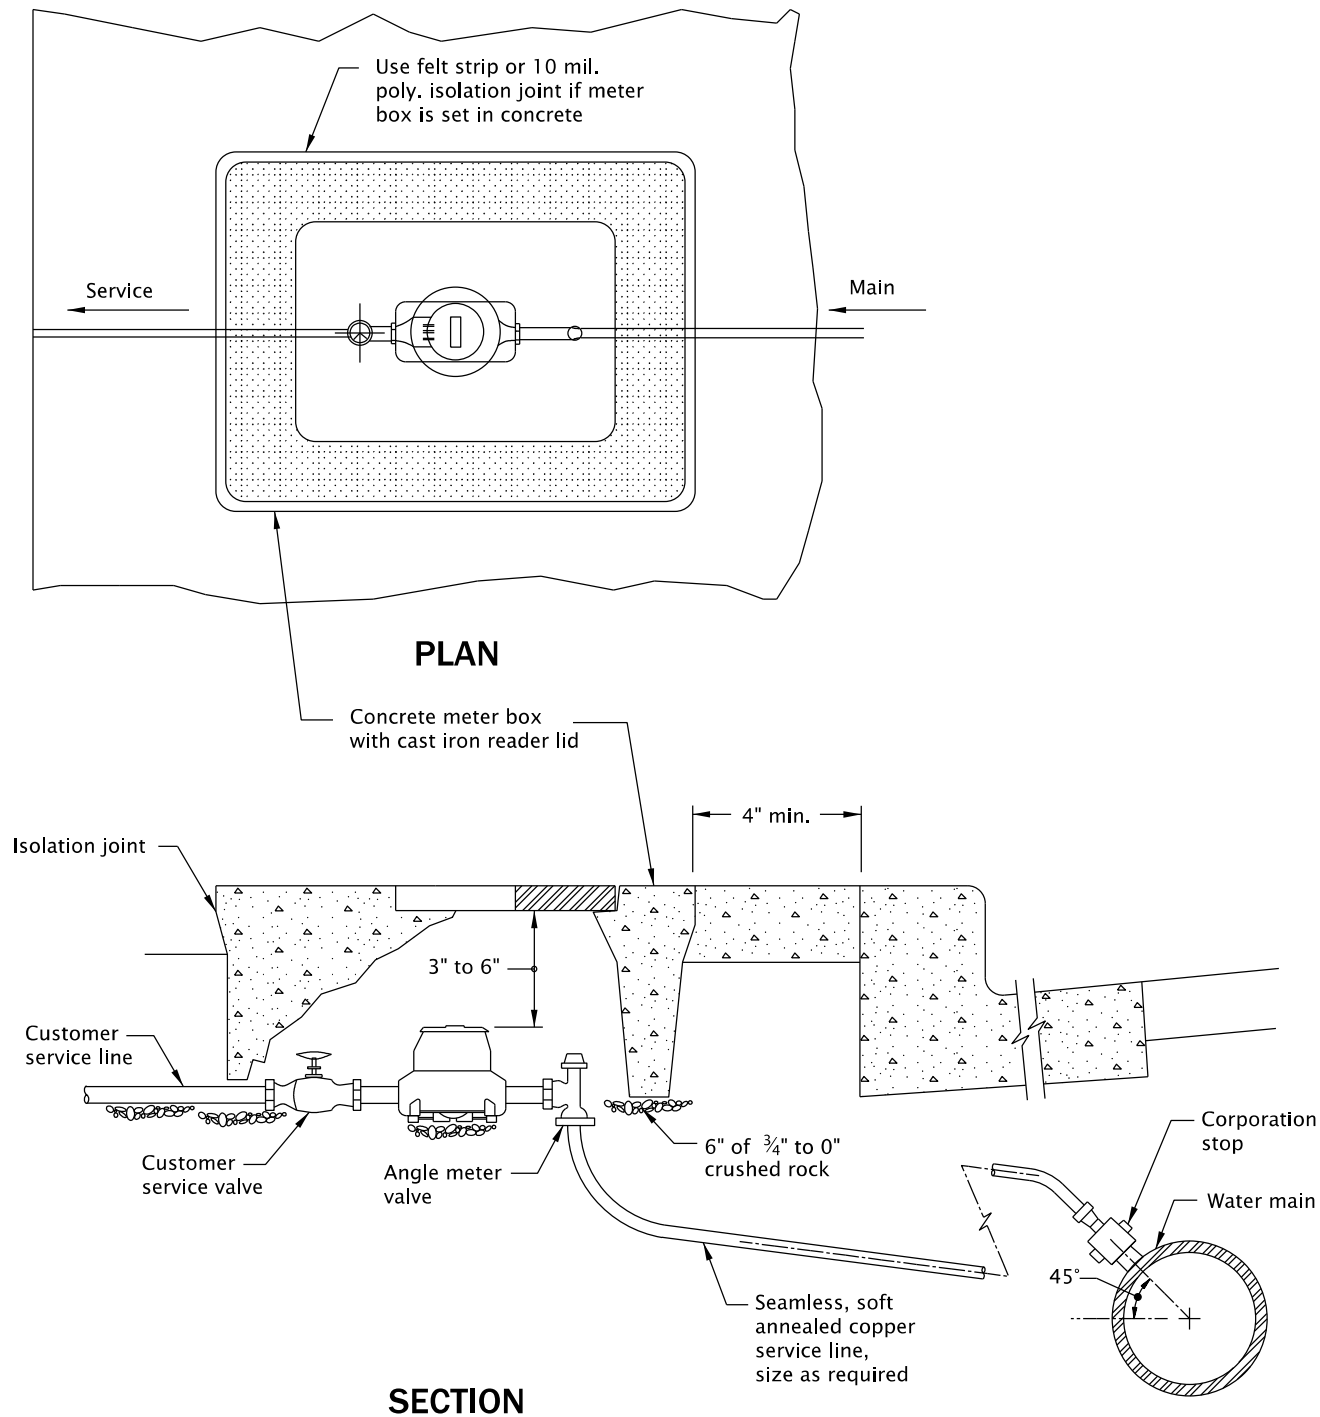

GENERAL NOTES FOR ALL DETAILS ON THIS SHEET:

1. Meter to be centered and set plumb inside meter box.
2. Manufactured meter setter may be used for 3/4" to 2" services.
3. Set meter box 4" minimum behind curb or sidewalk.
4. Meter boxes set in driveways shall have traffic lids.
5. See project plans for meter box size.
6. See project plans for details not shown.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.

OREGON STANDARD DRAWINGS

3/4" TO 2"
WATER SERVICE CONNECTION

2024

DATE	REVISION	DESCRIPTION

CALC. BOOK NO. N/A SDR DATE- 25-JUL-2017 - RD274

Effective Date: June 1, 2026 – November 30, 2026