



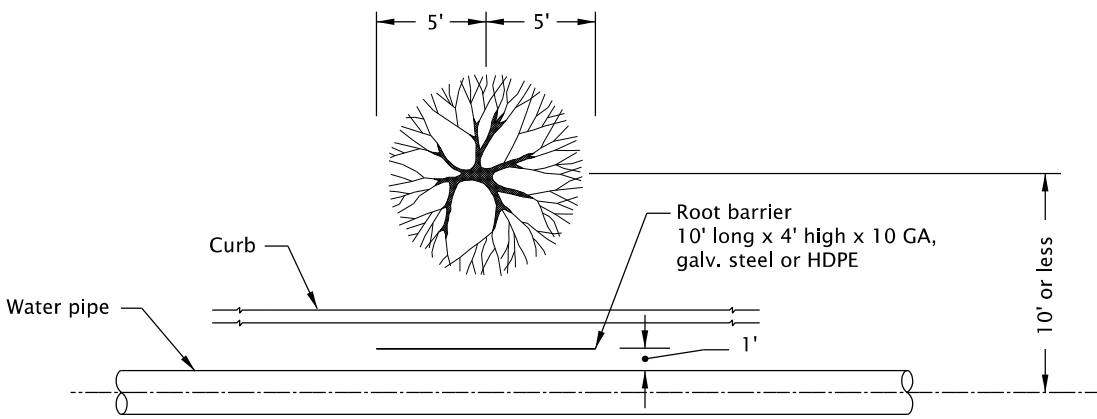

PLAN

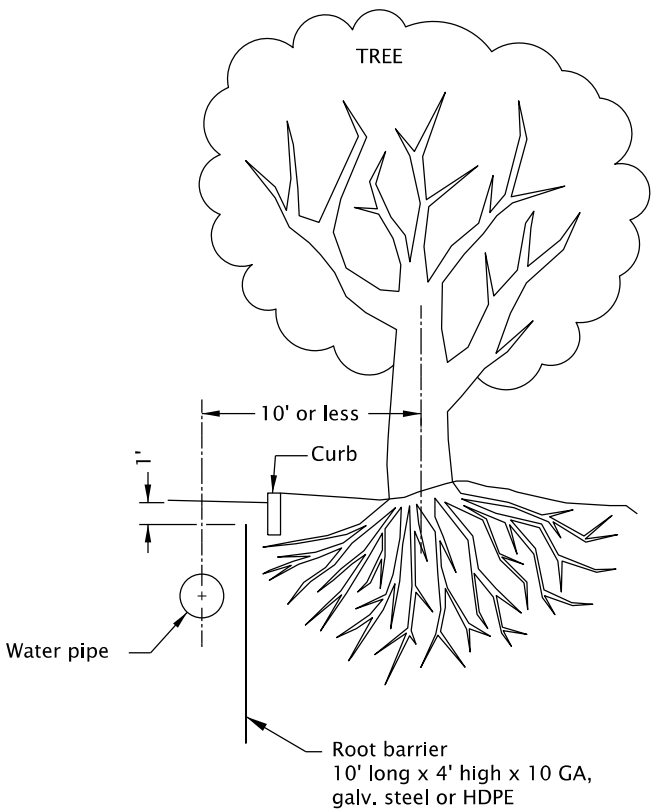

SECTION

GENERAL NOTES FOR ALL DETAILS ON THIS SHEET:

1. Where existing parkway trees have been root pruned, install continuous, lineal root barrier adjacent to the pipe.
2. Root sealer shall be applied to all cut root areas which are larger that 2" in diameter. The sealer shall be applied as soon as practical after the cuts have been made. Root sealer shall be approved by the engineer at least 48 hours in advance of the pruning operation.
3. Root barriers shall be fabricated from a high density, high impact plastic or hot dipped galvanized steel.
4. See project plans for details not shown.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.			
OREGON STANDARD DRAWINGS			
ROOT BARRIER			
2024			
DATE	REVISION DESCRIPTION		
CALC. BOOK NO.	N/A	SDR DATE	25-JUL-2017
RD286			