


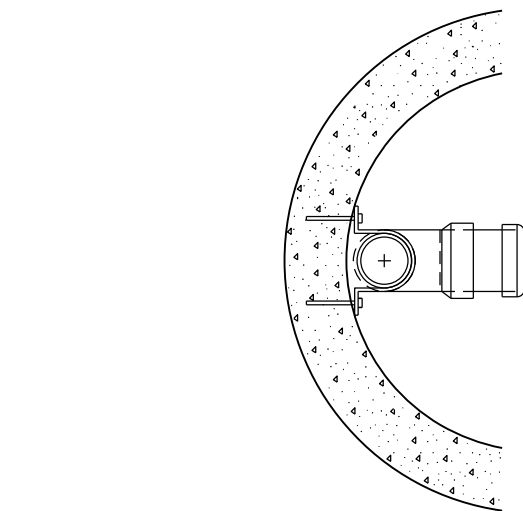

SECTION A-A
CLAMP DETAIL

1. Only one inside drop per manhole.
2. PVC shall be ASTM D3034 SDR35.
3. See Std. Dwg. RD336 for manhole steps details.
4. See Std. Dwg. RD336 for tracer wire details.
5. See Std. Dwg. RD345 for pipe to manhole connections,
6. See appropriate manhole standard drawings for details not shown.
7. Max. incoming pipe diameter 8". Drop pipe and fittings shall match incoming pipe.
8. Location, elevation, diameter, and slope of incoming pipe varies, see project plans.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.

OREGON STANDARD DRAWINGS
SANITARY SEWER PIPED
INSIDE DROP CONNECTION
FOR MANHOLES

2024

DATE		REVISION		DESCRIPTION
CALC. BOOK NO. --- N/A ---		SDR DATE 14-JUL-2014		RD350