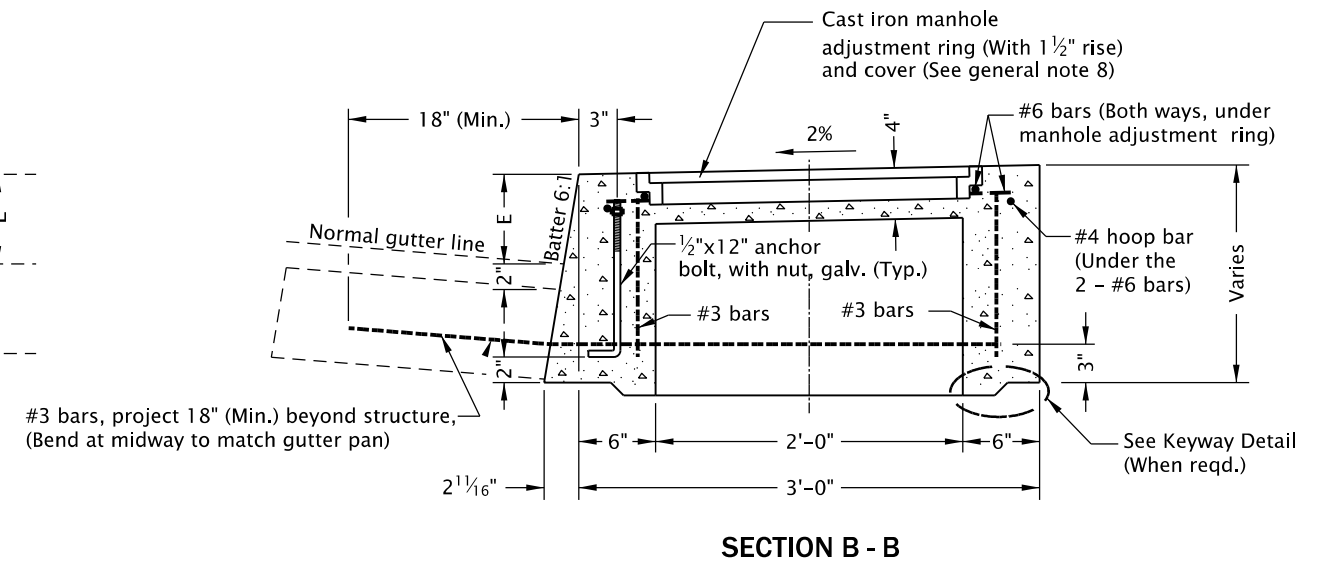
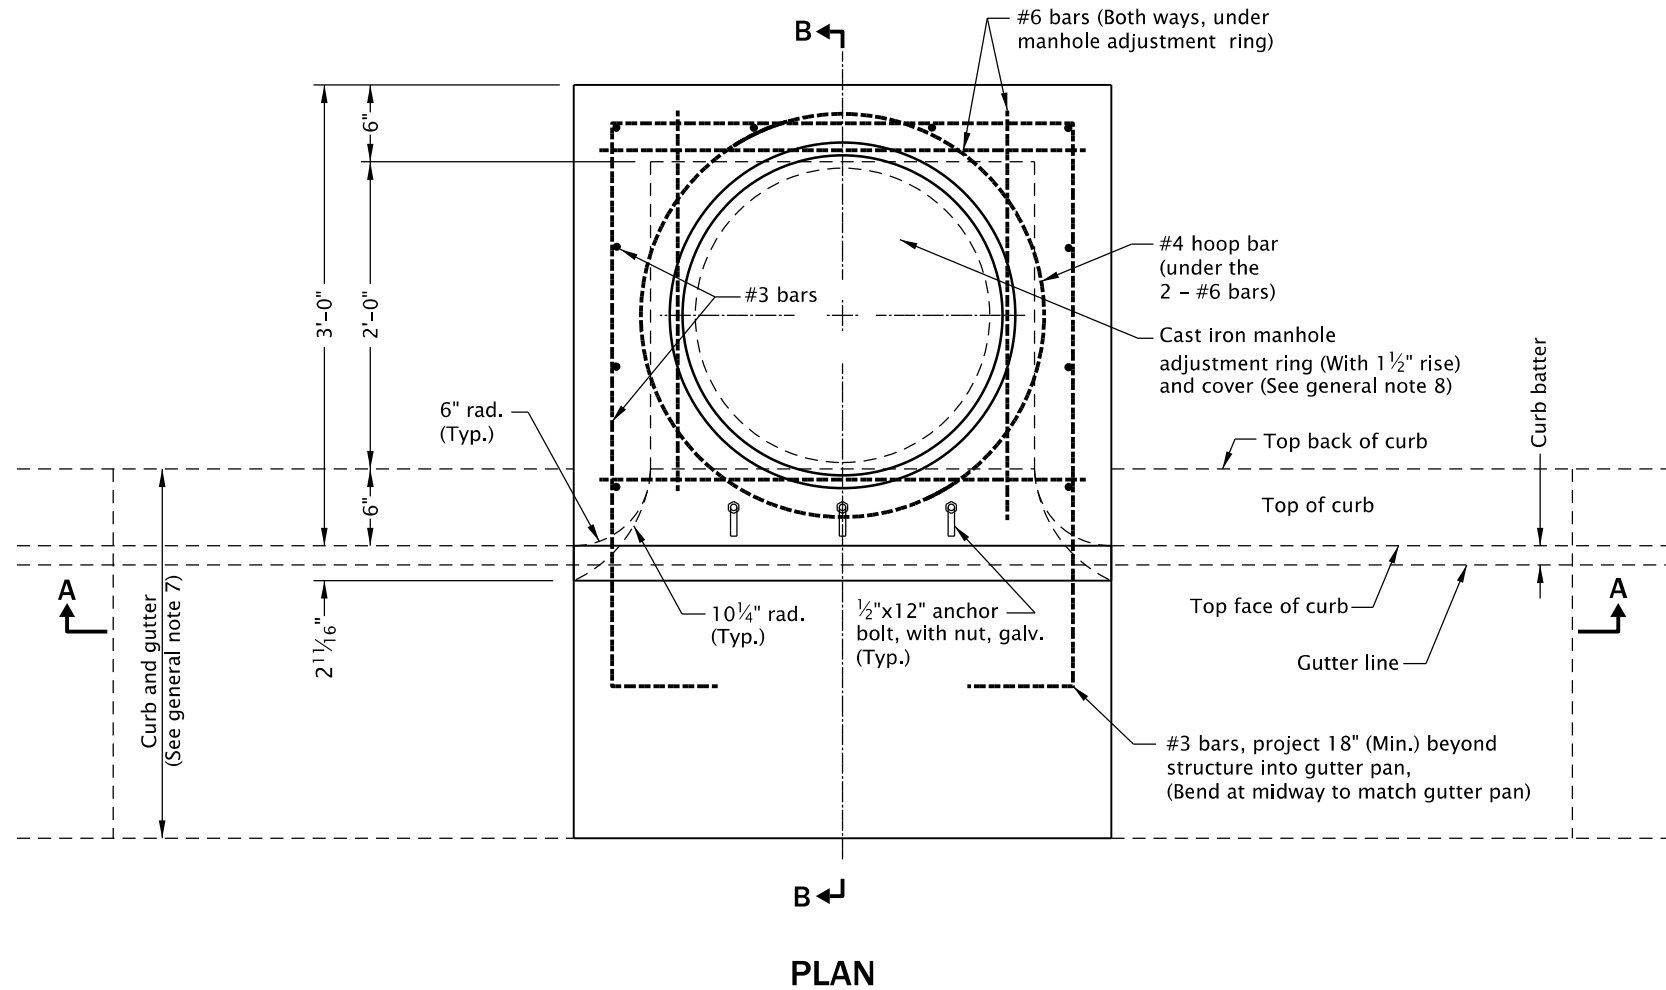
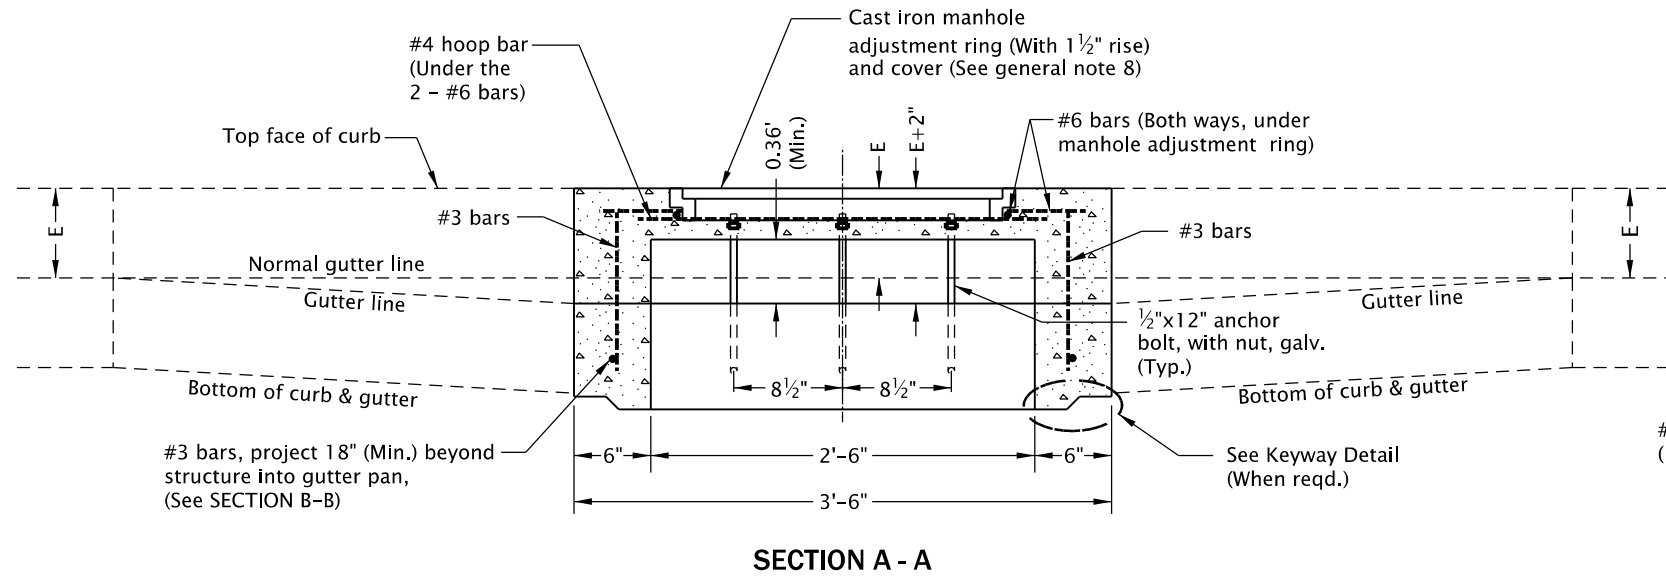


GENERAL NOTES FOR ALL DETAILS ON THIS SHEET:

1. All concrete shall be commercial grade concrete.
2. Inlet top may be cast-in-place or precast. All precast inlets shall conform to requirements of ASTM C913.
3. All reinforcement shall be 2" clear of nearest face of conc., unless otherwise shown.
4. Vary anchor bolt length and reinforcing bar placement as required by curb exposure E (See note 7 below).
5. See Std. Dwg. RD371 for inlet base details.
6. See Std. Dwg. RD371 for inlet pay limit.
7. See Std. Dwgs. RD700 & RD701 for curb and gutter details.
8. See Std. Dwg. RD356 for cast iron manhole adjustment ring and cover.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.

OREGON STANDARD DRAWINGS

CONCRETE INLET TOP
OPTION 1, TYPE CG-3

2024

DATE	REVISION	DESCRIPTION

CALC. BOOK NO. - - -	N/A - - -	SDR DATE - 16-JAN-2019 -	RD372
----------------------	-----------	--------------------------	-------

Effective Date: June 1, 2026 – November 30, 2026