
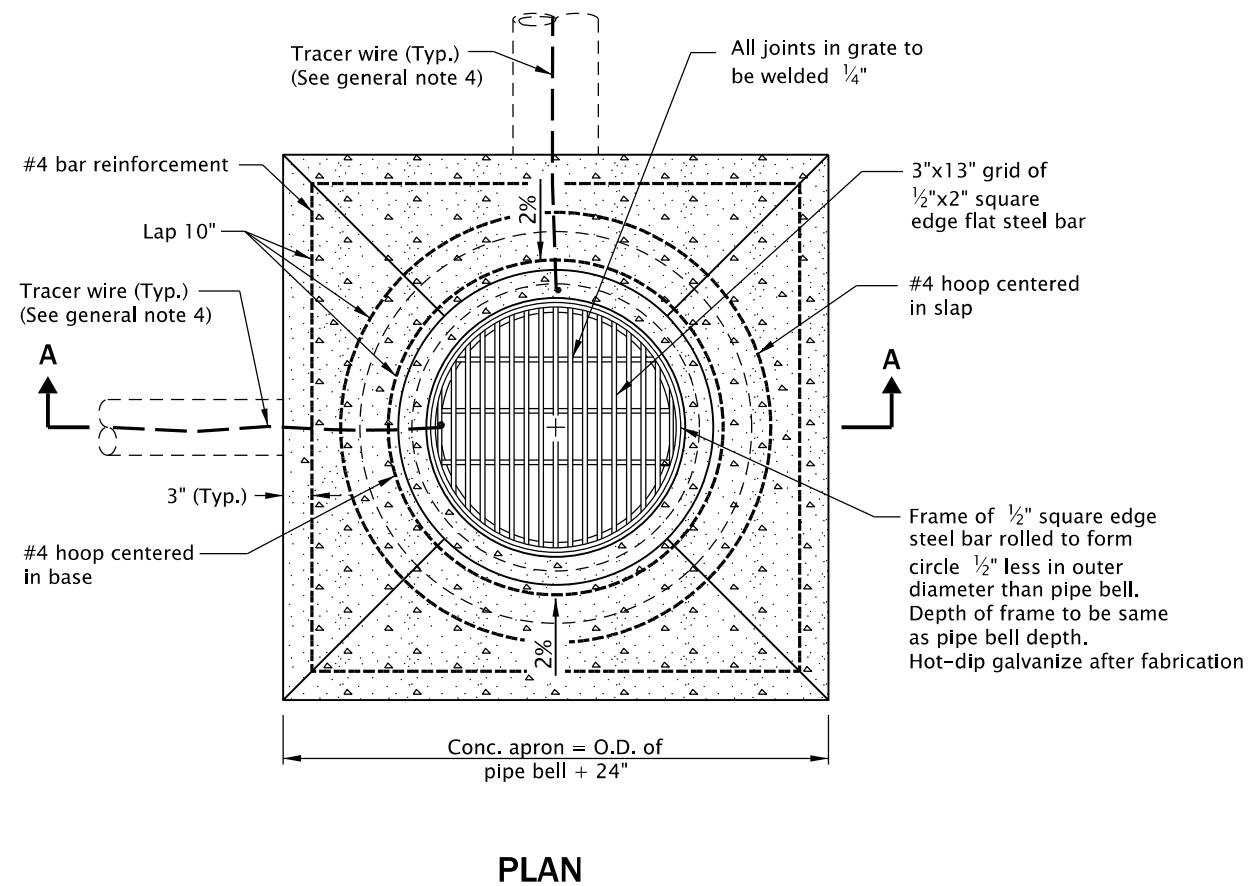


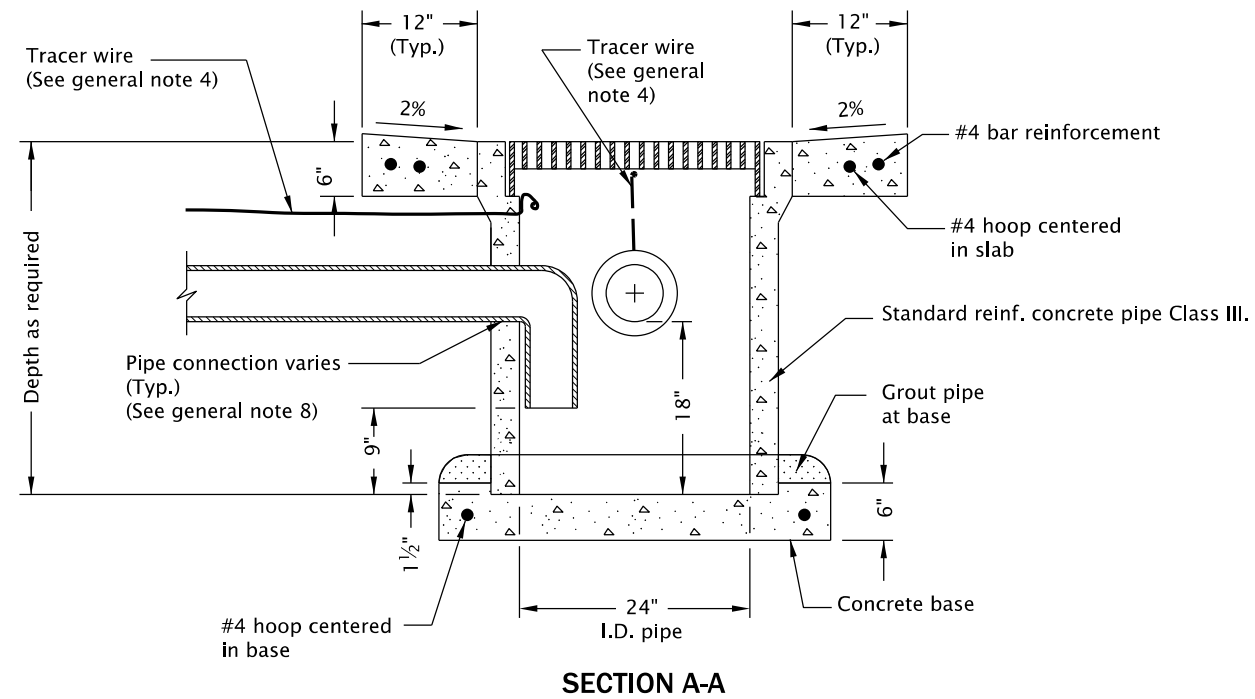

GENERAL NOTES FOR ALL DETAILS ON THIS SHEET:

1. Grates shall be bicycle-safe.
2. Precast concrete inlets may be used when specified or approved.
All precast inlets shall conform to requirements of ASTM C913.
3. Anchor vertical leg of inlet pipe if not a glued joint.
4. See Std. Dwg. RD336 for tracer wire details.
5. All reinforcement shall be 2" clear of nearest face of conc., unless otherwise shown.
6. Max. connecting pipe diameter varies with pipe material.
7. All concrete shall be commercial grade concrete.
8. See Std. Dwg. RD339 for pipe to structure connections.
9. Location, elevation, diameter, slope, and number of pipe(s) varies, see project plans.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without first consulting a Registered Professional Engineer.

All materials shall be in accordance with the current Oregon Standard Specifications.

OREGON STANDARD DRAWINGS

**AREA DRAINAGE BASIN
OR FIELD INLET**

2024

DATE	REVISION	DESCRIPTION
CALC. BOOK NO. - - - - N/A - - - -	SDR DATE - 14-JUL-2014 -	RD374