



ROADSIDE DEVELOPMENT IRRIGATION DETAILS

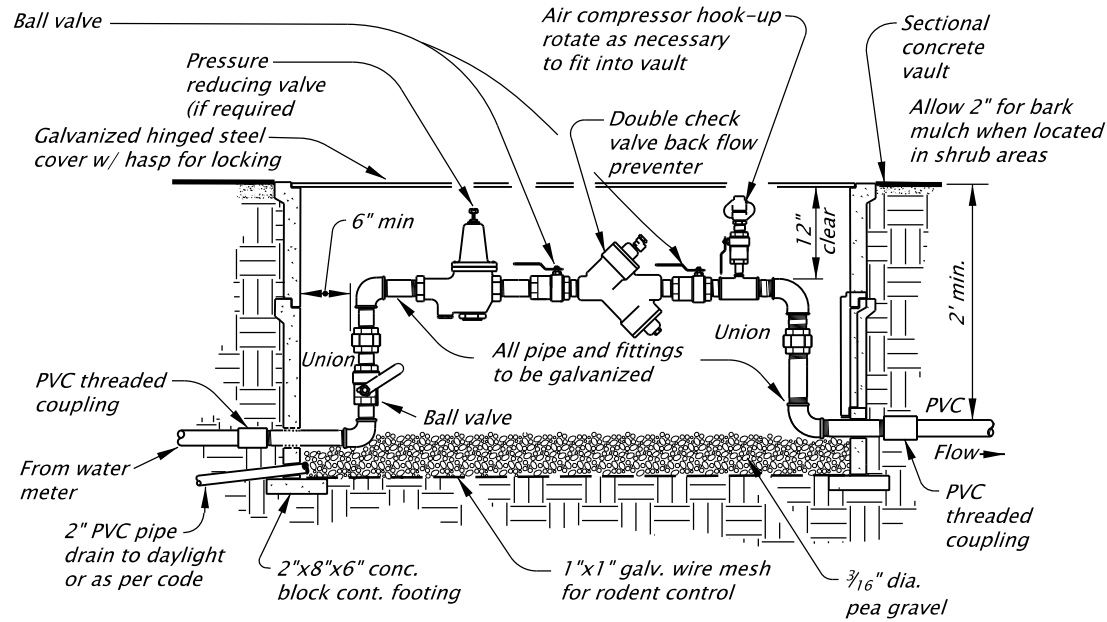


Notes:

1. Install backflow prevention assembly in accordance with "Accepted Procedure and Practice in Cross Connection Control Manual"
2. Comply with local jurisdiction requirements. These may vary from those shown on drawings, verify compliance.
3. Provide 6" access clearance for devices 2" and smaller.
4. Size of double check valve shown on plans or specifications.


BACKFLOW PREVENTION ASSEMBLY

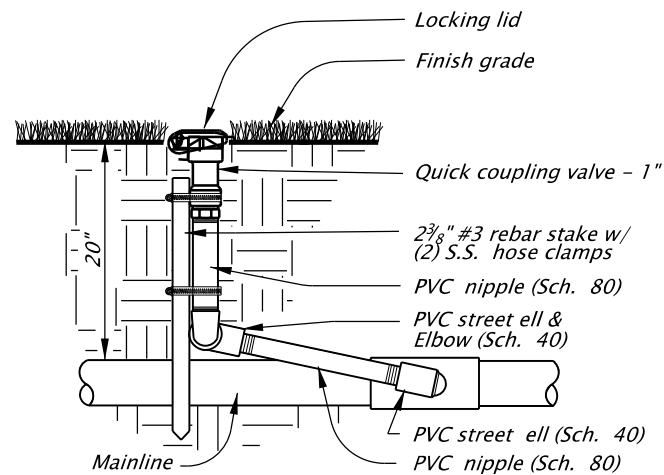


QUICK COUPLING VALVE

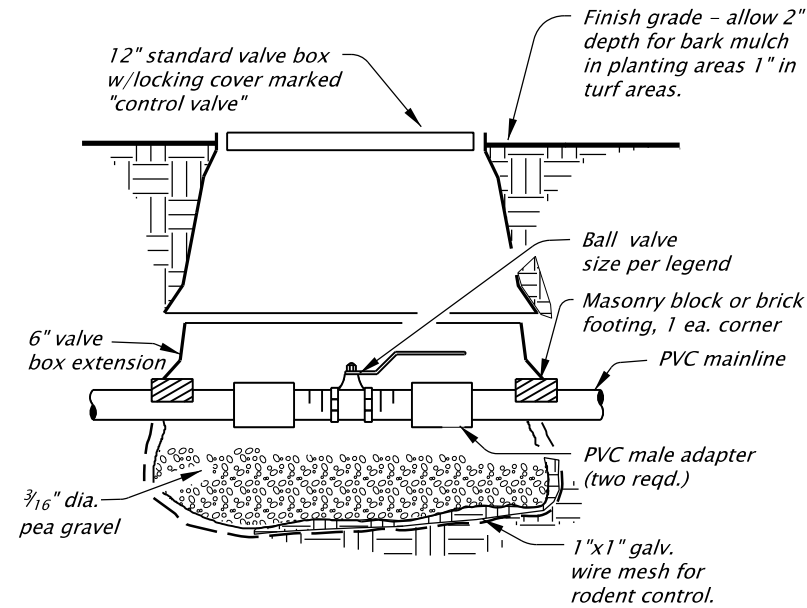


BALL VALVE & BOX

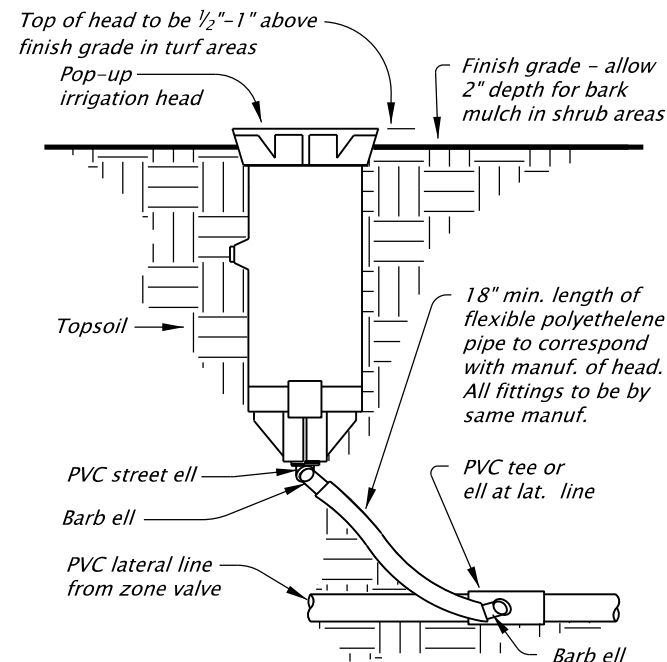

SPRINKLER HEAD AND JOINTS

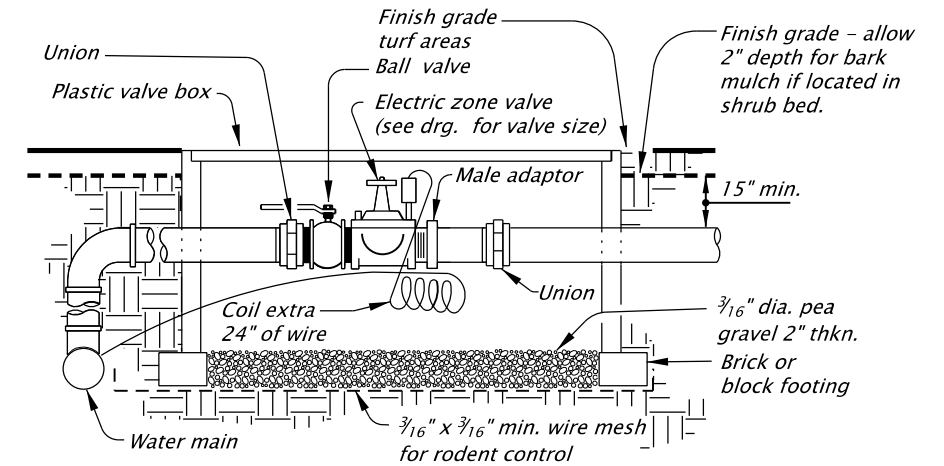

ELECTRIC ZONE VALVE

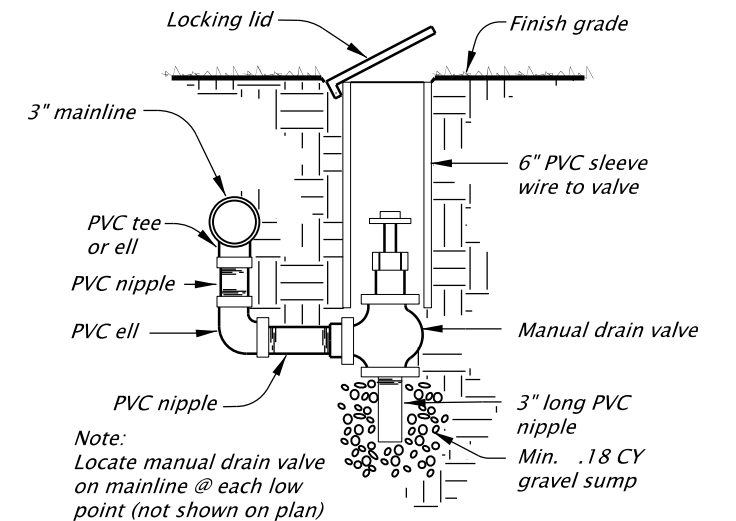

MANUAL DRAIN VALVE

The selection and use of this detail, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.

OREGON DEPARTMENT OF TRANSPORTATION
TECHNICAL SERVICES
DETAILS

IRRIGATION DETAILS

DETAIL NO.

DET6109