
APPROVED By Oregon DEQ at 2:24 pm, Nov 09, 2007

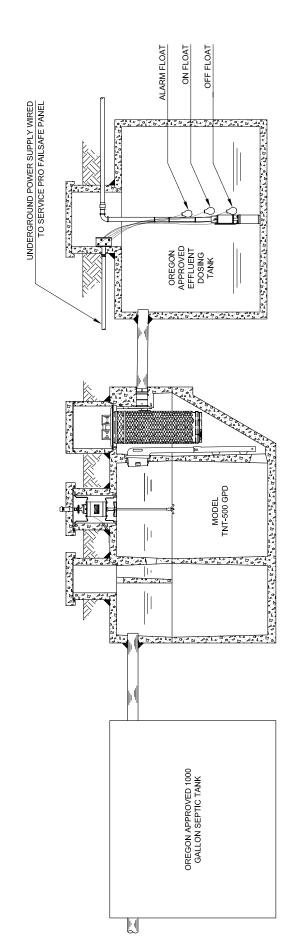


TREATMENT STANDARD #1 - PRESSURE DISTRIBUTION TO RECEIVING ENVIRONMENT

GENERAL NOTES:

- 1. FAILSAFE CONTROLS WILL SHUT DOWN EFFLUENT PUMP IF THERE IS A MALFUNCTION IN THE AERATOR OPERATION.
- 2. FAILSAFE CONTROLS WILL ALARM AND NOTIFY THE SERVICE PROVIDER IN THE EVENT OF A MALFUNCTION.
 - 3. FAILSAFE CONTROLS WILL ALARM IF EFFLUENT LEVEL REACHES THE ALARM FLOAT.

	10-18-07 D	BDS BDS	_{вмте} 8-29-07	STN NTS	DOMES IN PC-5-9935	
PART NUMBER:	norweco.	TREATMENT STANDARD #1	FLOW THROUGH SCHEMATICS		THE DESCRIPTION OF THE PROPERTY OF NORWALK WASTRANTED SOLIDARITH COMPANY, AND SAY NOT BE COPIED OR REPRODUCED IN WHOLE OF M PART WITHER PERMISSION PROM HORWECO.	
	U.S.	MMVII				

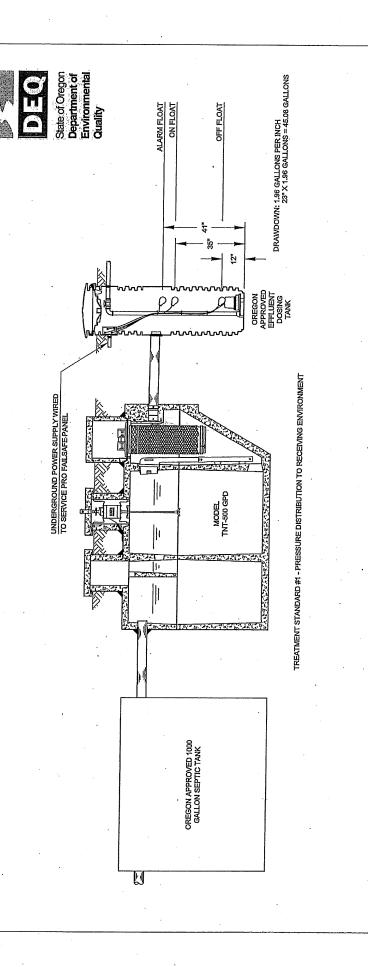

GENERAL NOTES:

- FAILSAFE CONTROLS WILL SHUT DOWN EFFLUENT PUMP IF THERE IS A MALFUNCTION IN THE AERATOR OPERATION.
 FAILSAFE CONTROLS WILL ALARM AND NOTIFY THE SERVICE PROVIDER IN THE EVENT OF A MALFUNCTION.
 FAILSAFE CONTROLS WILL ALARM IF EFFLUENT LEVEL REACHES THE ALARM FLOAT.

	08-15-2013 A	JIMM	JMM	07-29-2013	NTS	PC-5-3993
FAR! NUMBER:	norweco.		TREATMENT STANDARD #1	SCHEMATICS		CONTRACTOR OF THE PROPERTY OF
,	U.S. AND FOREIGN PATENTS PENDING					MANDUIL