


Halfway Elementary School

Pine Eagle SD 61

Bake_sch04A

Building Type	County
School	Baker
Street	
150 W Bell St	
City	State Zip
Halfway	OR 97834
Latitude	Longitude
44.88122	117.11456
Tracking Code	Inspection Date
RVS in 2006	8/11/2006

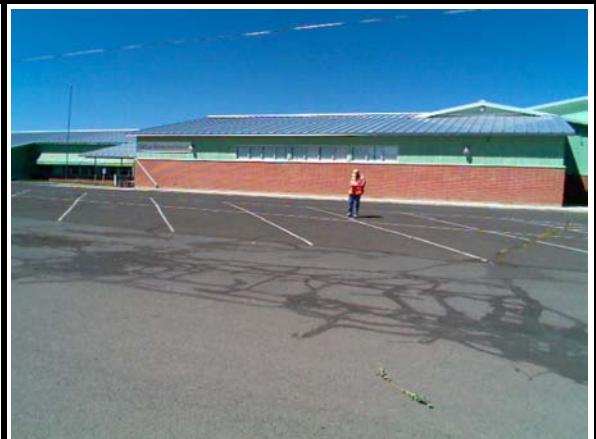

Seismicity Zone: Moderate

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	W2	4.8	-3	-0.5	0	0	0	-1.2	0	0.1
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Halfway Elementary School

Final RVS Score

Final Type	Final Score
W2	0.1

FEMA-154 Collapse Potential

High (>10%)



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries

Halfway Elementary School

Bake_sch04A

Enrollment 94	Year Built (Field Verified) 1945	Year Built (Alt. Source) 1945	Est. Decade Built 1960
Total Area (square ft) 35600	Number of Stories 1	Basement	Pounding Potential No
Plan Irregularities Reentrant Corners: U shaped Reentrant Corners: Other None		Vertical Irregularities Steps in Elevation View: 2 to 3 Changes None None	
Falling Hazards None None None		Poor Conditions None None None	
 N Elevation View			

Halfway Elementary School

Pine Eagle SD 61

Bake_sch04B

Building Type School	County Baker	
Street 150 W Bell St		
City Halfway	State OR	Zip 97834
Latitude 44.88121	Longitude 117.11518	
Tracking Code RVS in 2006	Inspection Date 8/11/2006	



Seismicity Zone: Moderate

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	W2	4.8	0	-0.5	0	0	0	-1.2	0	3.1
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Halfway Elementary School

Final RVS Score

Final Type	Final Score
W2	3.1

FEMA-154 Collapse Potential

Low (<1%)



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries

Halfway Elementary School

Bake_sch04B

Enrollment 94	Year Built (Field Verified) 1945	Year Built (Alt. Source) 1945	Est. Decade Built 1970
Total Area (square ft) 35600	Number of Stories 1	Basement	Pounding Potential No
Plan Irregularities Reentrant Corners:L shaped (Adjacent Build/Entity) Reentrant Corners: L Shaped None		Vertical Irregularities None None None	
Falling Hazards None None None		Poor Conditions None None None	
			
W Elevation View		S Elevation View	



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries