

Cannon Beach Elementary

Clat_sch04A

Seaside SD 10

Building Type		County	
School		Clatsop	
Street			
268 Beaver St			
City	State	Zip	
Cannon Beach	OR	97110	
Latitude		Longitude	
45.90148		123.95918	
Tracking Code		Inspection Date	
RVS in 2006		9/18/2006	



Seismicity Zone: Very High

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	W2	3.8	0	0	0	0	-0.4	0	0	3.4
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Cannon Beach Elementary

Final RVS Score

Final Type

Final Score

W2

3.4

FEMA-154 Collapse Potential

Low (<1%)



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries

Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
117		1950	1950
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
16472	1	No	Yes

Plan Irregularities	Vertical Irregularities
None	None
None	None
None	None


Falling Hazards	Poor Conditions
Other: Brick Veneer	None
Unreinforced Chimneys	None
None	None



SE Elevation View



S Falling Hazard

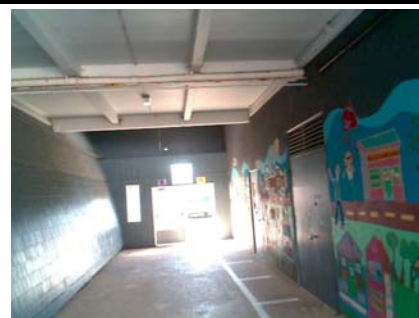

NW Pounding Potential



N Elevation View




NW Elevation View



W Elevation View



NW General Site

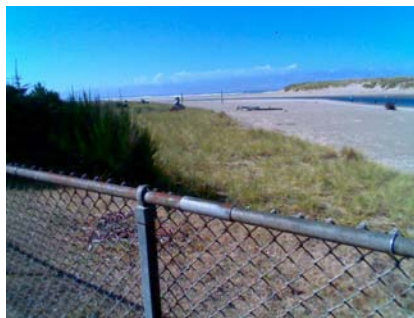SW Other
elevation <5ft, photo taken from play ground.

Cannon Beach Elementary

Clat_sch04B

Seaside SD 10

Building Type		County	
School		Clatsop	
Street			
268 Beaver St			
City	State	Zip	
Cannon Beach	OR	97110	
Latitude		Longitude	
45.90158		123.95879	
Tracking Code		Inspection Date	
RVS in 2006		9/18/2006	



Seismicity Zone: Very High

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	W2	3.8	-2	-0.5	0	0	-0.4	0	0	0.9
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Cannon Beach Elementary

Final RVS Score

Final Type

Final Score

W2

0.9

FEMA-154 Collapse Potential

High (>10%)



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries

Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
117		1950	1950
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
16472	2	No	Yes

Plan Irregularities	Vertical Irregularities
Reentrant Corners: L Shaped	Steps in Elevation View: 2 to 3 Changes
None	None
None	None

Falling Hazards	Poor Conditions
Other: General	None
None	None
None	None



NE Vertical Irregularity Primary




SE Plan Irregularity Primary



SW Primary Structural Type



SW Primary Structural Type

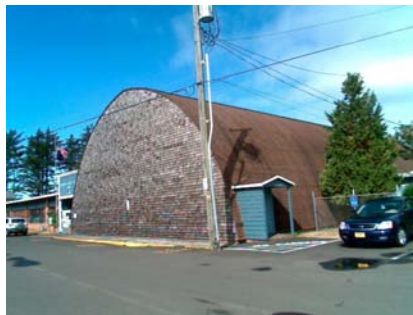

SE Elevation View



SW Pounding Potential