

# Pine Grove VFD

Hood\_fir03A

Pine Grove VFD

Building Type		County	
Fire - RFPD		Hood	
Street			
2995 Van Horn Drive			
City	State	Zip	
Hood River	OR	97031	
Latitude		Longitude	
45.6531		121.51282	
Tracking Code		Inspection Date	
RVS in 2006		8/4/2006	



Seismicity Zone: Moderate

## FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	C2	3.6	-2	-0.5	0	0	-0.8	0	0	0.3
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Pine Grove VFD

## Final RVS Score

Final Type

Final Score

C2

0.3

## FEMA-154 Collapse Potential

High (>10%)



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment  
Oregon Department of Geology and Mineral Industries


Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
			1950
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
	1	No	No

Plan Irregularities	Vertical Irregularities
Reentrant Corners: L Shaped	Steps in Elevation View: Single Change
Lateral-Force-Resistance in One Direction Only	None
None	None

Falling Hazards	Poor Conditions
None	None
None	None
None	None



N Elevation View

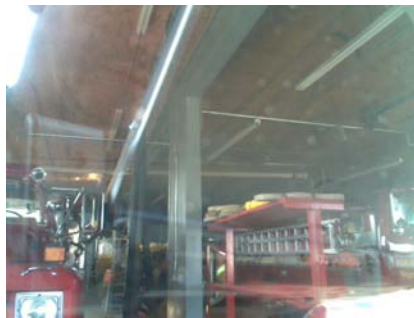

N Primary Structural Type



S Elevation View



S Primary Structural Type

Building Type		County	
Fire - RFPD		Hood	
Street			
3431 O'Dell Highway			
City		State	Zip
Hood River		OR	97031
Latitude		Longitude	
45.6531		121.51273	
Tracking Code		Inspection Date	
RVS in 2006		8/4/2006	

Seismicity Zone: High

## FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	RM1	2.8	0	-0.5	0	0	-0.4	0	0	1.9
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Odell RFPD

## Final RVS Score

Final Type

Final Score

RM1

1.9

## FEMA-154 Collapse Potential


Moderate (&gt;1%)



Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
			1990
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
	1	No	No

Plan Irregularities	Vertical Irregularities
Torsion: Eccentric Stiffness	None
None	None
None	None

Falling Hazards	Poor Conditions
None	None
None	None
None	None





# Pine Grove VFD

Hood\_fir03C

Pine Grove VFD

Building Type		County	
Fire - RFPD		Hood	
Street			
2995 Van Horn Drive			
City	State	Zip	
Hood River	OR	97031	
Latitude		Longitude	
45.6531		121.51263	
Tracking Code		Inspection Date	
RVS in 2006		8/7/2006	



Seismicity Zone: Moderate

## FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	PC1	3.2	0	-0.5	0	0	-0.6	0	0	2.1
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0

Pine Grove VFD

## Final RVS Score

Final Type

Final Score

PC1

2.1

## FEMA-154 Collapse Potential

Low (<1%)



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment  
Oregon Department of Geology and Mineral Industries

Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
			1970
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
	1	No	No

Plan Irregularities	Vertical Irregularities
Lateral-Force-Resistance in One Direction Only	None
None	None
None	None

Falling Hazards	Poor Conditions
None	None
None	None
None	None