

Horticulture and Fisheries

Mult_coc01A

Mt Hood CC

Building Type	County
Community_College	Multnomah
Street	
26000 Se Stark St	
City	State Zip
Gresham	OR 97030
Latitude	Longitude
45.51838	122.39141
Tracking Code	Inspection Date
Miller 2004-05	7/20/2005

Seismicity Zone: High

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	W2	3.8	-2	-0.5	0	0	0	0	0	1.3
Secondary		0	0	0	0	0	0	0	0	0
Tertiary		0	0	0	0	0	0	0	0	0


Horticulture and Fisheries

Final RVS Score

Final Type	Final Score
W2	1.3

FEMA-154 Collapse Potential

Moderate (>1%)

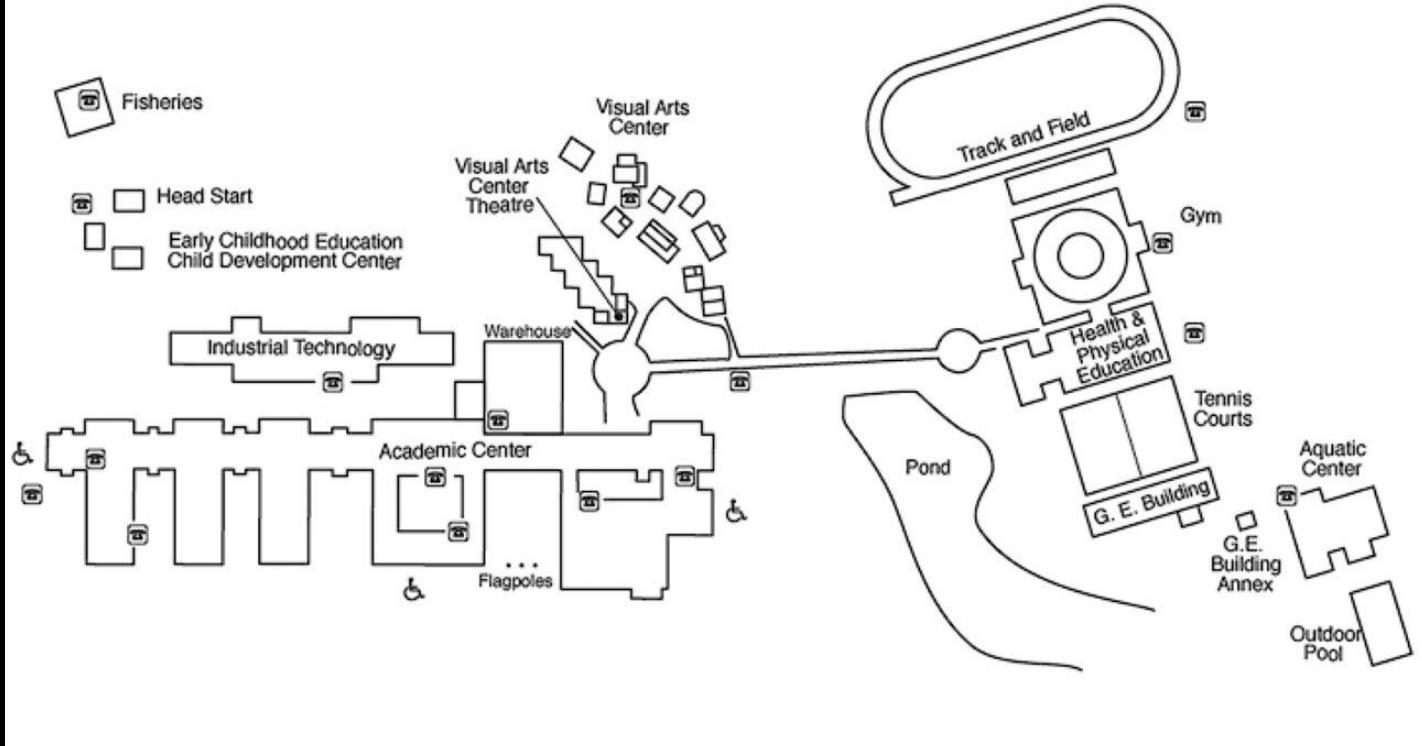

OregonGeology

Horticulture and Fisheries

Mult_coc01A

Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
	1975	1975	1970
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
12200	1	No	No
Plan Irregularities		Vertical Irregularities	
Yes: Unknown		None	
Falling Hazards		Poor Conditions	
None			
None			
None			