

OHSU Hospital

OHSU

Mult_hos04A

Building Type	County
Hospital	Multnomah
Street	
3181 SW Sam Jackson Park Rd	
City	State Zip
Portland	OR 97239
Latitude	Longitude
45.49922	122.68534
Tracking Code	Inspection Date
New Building	7/3/2006



Seismicity Zone: High

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	C2	3.6	-1	-0.5	0	0	-0.4	0	0	1.7
Secondary	C1	3.1	-1.5	-0.5	0	0	-0.4	0	0	0.7
Tertiary	S2	3.8	-1.5	-0.5	0	0	-0.4	0	0	1.4


OHSU Hospital

Final RVS Score

Final Type	Final Score
C1	0.7

FEMA-154 Collapse Potential

Low (<1%)

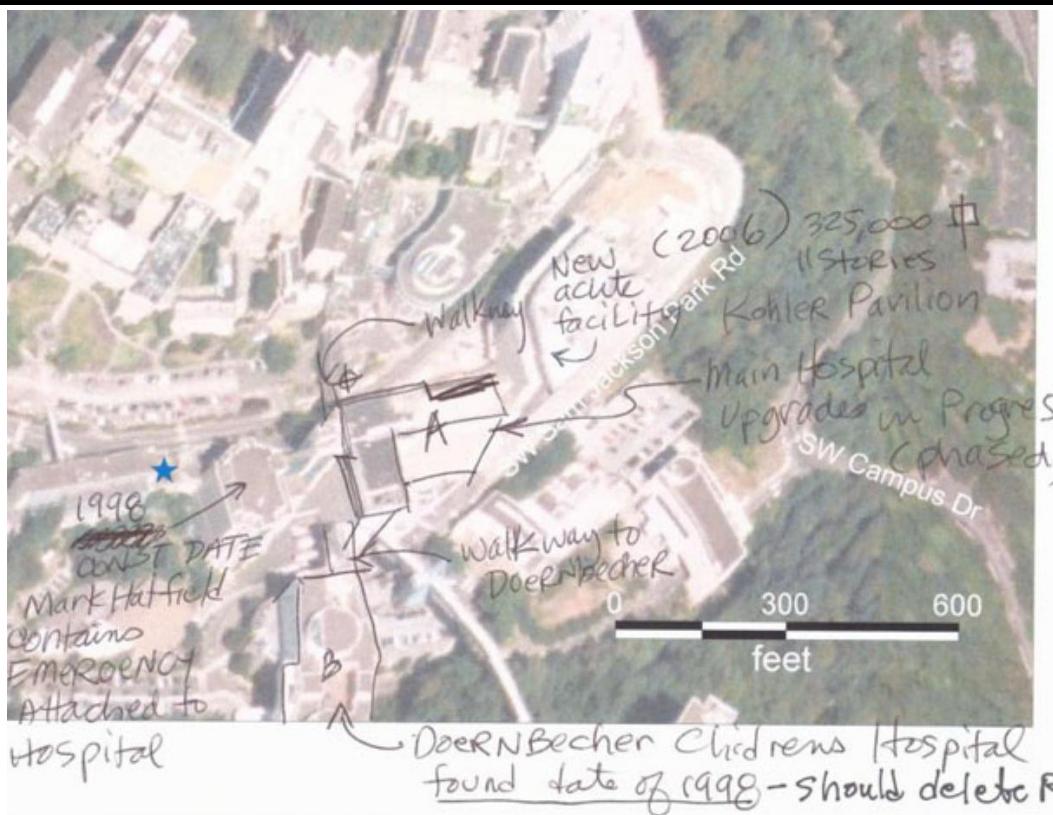

OregonGeology

OHSU Hospital

Mult_hos04A

Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
	1956	2006	1950
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
585000	14	No	No
Plan Irregularities		Vertical Irregularities	
Reentrant Corners: L Shaped		Building On Hill or Sloped Site	
Out of Plane Lateral-Force-Resistance Elements		None	
None		None	
Falling Hazards		Poor Conditions	
Other: Brick Veneer		None	
Other: General		None	
None		None	



N Plan Irregularity Secondary



SW Elevation View



SW Elevation View



S Seismic Upgrade



S Elevation View



S Plan Irregularity Primary



W Field Verified Year Built



NW Seismic Upgrade
STEEL BRACES CAN BE OBSERVED IN THE WINDOWS OF THE MAIN HOSPITAL



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries

OHSU Hospital

OHSU

Mult_hos04B

Building Type	County
Hospital	Multnomah
Street	
3181 SW Sam Jackson Park Rd	
City	State Zip
Portland	OR 97239
Latitude	Longitude
45.49802	122.68574
Tracking Code	Inspection Date
New Building	7/3/2006



Seismicity Zone: High

FEMA 154 Rapid Visual Screening Score Card

	Type	Basic Score	Vert Irreg	Plan Irreg	Pre-Code	Post-Bench	Soil C	Soil D	Soil E	RVS Score
Primary	C1	3.1	-1.5	0	0	1.4	-0.4	0	0	2.6
Secondary	S2	3.8	-1.5	0	0	1.4	-0.4	0	0	3.3
Tertiary		0	0	0	0	0	0	0	0	0


OHSU Hospital

Final RVS Score

Final Type	Final Score
C1	2.6

FEMA-154 Collapse Potential


Low (<1%)

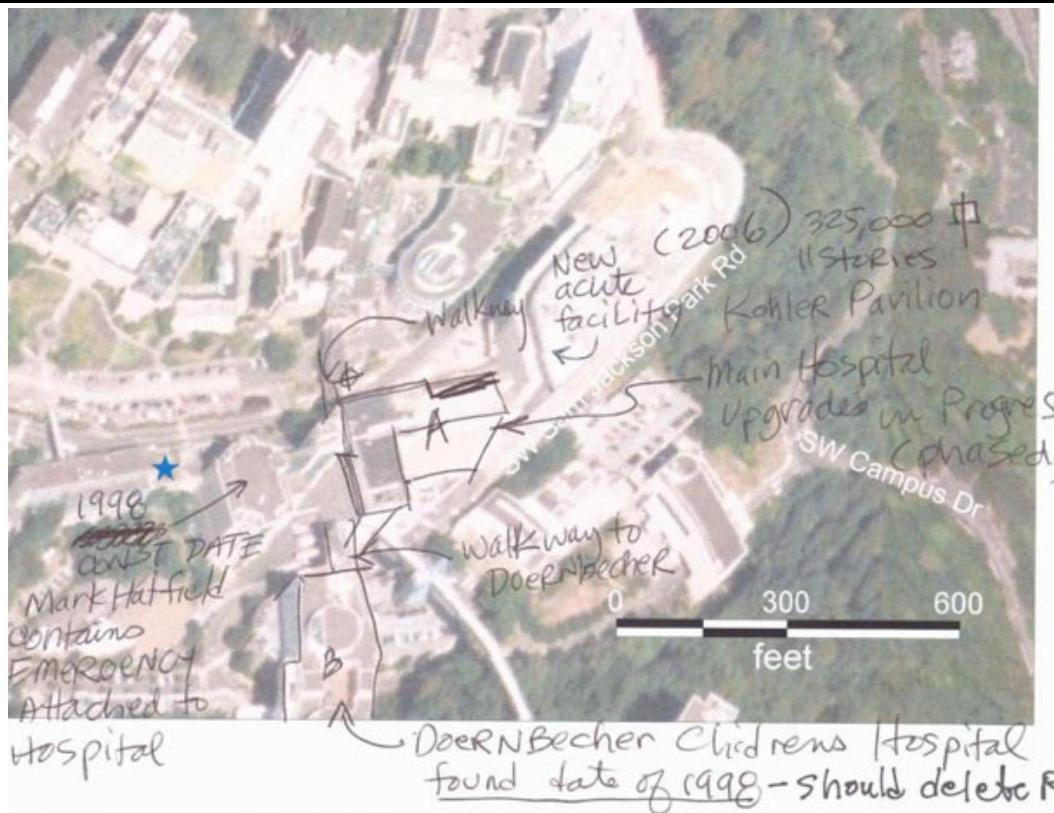

OregonGeology

OHSU Hospital

Mult_hos04B

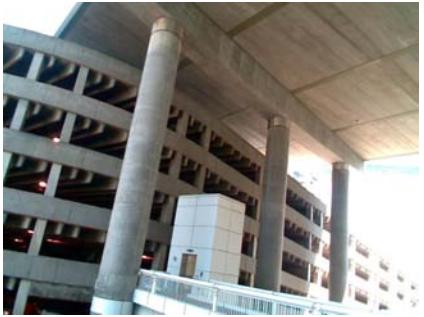Enrollment	Year Built (Field Verified)	Year Built (Alt. Source)	Est. Decade Built
	1998	2006	1990
Total Area (square ft)	Number of Stories	Basement	Pounding Potential
585000	10	No	Yes
Plan Irregularities		Vertical Irregularities	
Out of Plane Lateral-Force-Resistance Elements		Steps in Elevation View: Very Irregular Changes	
None		None	
None		None	
Falling Hazards		Poor Conditions	
None		None	
None		None	
None		None	
			
W	Elevation View	SW	Elevation View
			
		NW Primary Structural Type	
			
E	Elevation View	W	Field Verified Year Built



OregonGeology

Rapid Visual Screening - Senate Bill #2 - Seismic Needs Assessment
Oregon Department of Geology and Mineral Industries