




OPRD ADA Quick Reference Guide – Restroom & Shower


Wheelchair Accessible Toilet

Toilet positioned with a wall or partition to the rear and to one side. The centerline of the water closet shall be 16" min to 18" max from the side wall. The seat height shall be 17"-19" maximum measured to the top of the seat.

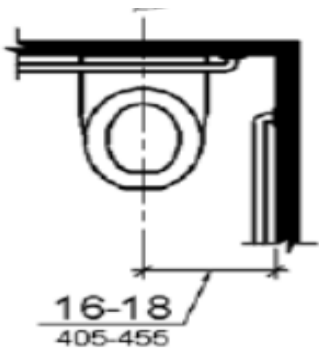


Side Wall Grab Bar

Side wall grab bar shall be 42" long min, located 12" max from the rear wall and extending 54" min from the rear wall

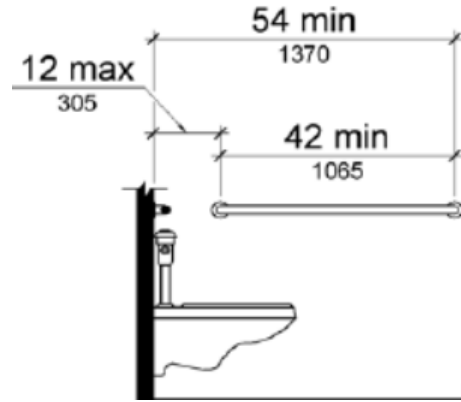


Wheelchair Toileting Clearance

Wheelchair clearance around toilet should be 60" from side wall and 56" from back rear wall for wall hung toilet or 59" for floor mounted

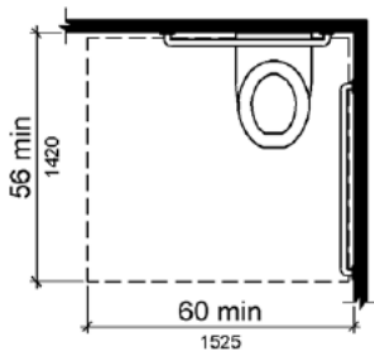


Soap, Paper Towel Dispensers or Dryers

Height 48" maximum
Reach 15" - 20" maximum

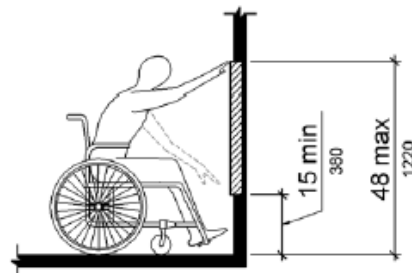


Urinals

Stall-type or wall-hung type with the rim should be 17" maximum above the floor

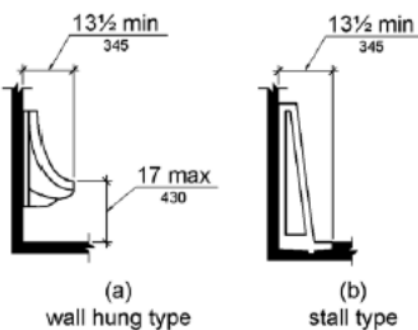

Toilet Room Technical Requirements

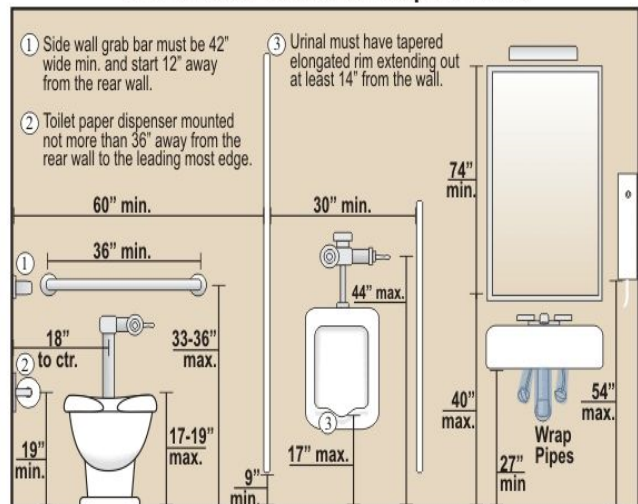


1 Texas Access, LLC




OPRD ADA Quick Reference Guide – Restroom & Shower

Door Swing

Doors shall not swing into the clear floor space or clearance required for any fixture.

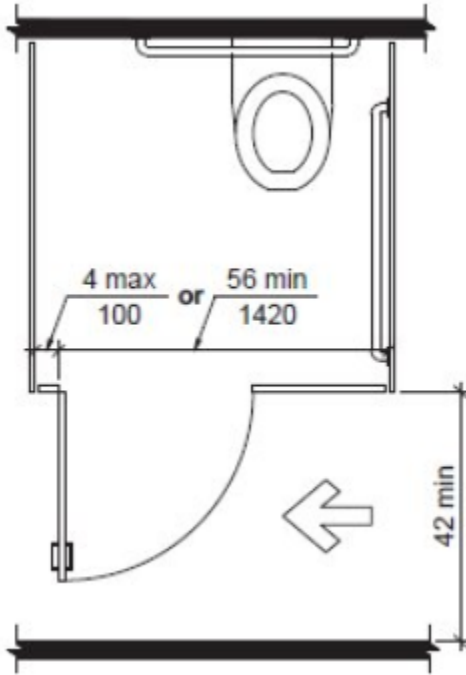


Door Swing – Alternative

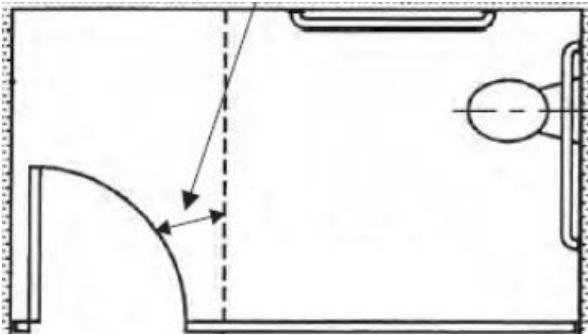

Door Hardware

Shall allow for one hand operation with no tight grasping, pinching, or twisting of the wrist. With no more than 5lb maximum weight. Located 34"-48" above floor.

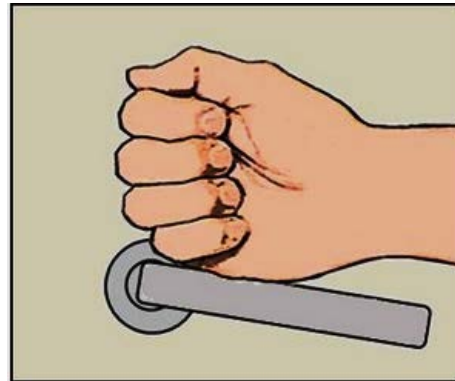

Exposed plumbing pipes

Water supply and drain pipes under lavatories and sinks shall be insulated or otherwise configured to protect against contact.

Garbage Can

(requires entry....)

Mirrors


Mirrors above countertops shall be installed with the bottom edge of the reflecting surface 40" maximum above the floor. Not located above a countertop shall be installed with the bottom edge of the reflecting surface 35" maximum above the floor.



OPRD ADA Quick Reference Guide – Restroom & Shower

Transfer Showers

Inside shower dimensions shall be at least 36" x 36" and shall have a 36" wide minimum entry on the face of the shower compartment with a 36" minimum wide clearance by 48" long minimum shall be provided for entry.

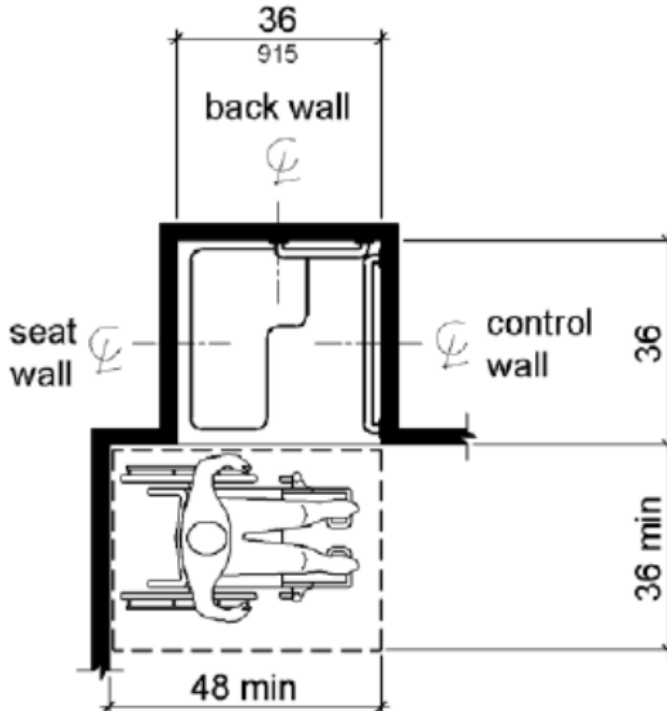

Shower seat

Shower seats shall be folding type in a roll-in shower compartment. The top of the seat shall be 17" minimum and 19" maximum above the bathroom floor.

Shower Compartments

Controls, faucets and shower spray unit shall be located above grab bar, no higher than 48" above shower floor with a 27" reach maximum.

Grab Bars

Grab bars shall be installed in a horizontal position 33" – 36" above the finish floor. They shall be provided across the control wall (opposite seat) and back wall, with the back wall being 18" from the control wall. Grab bars shall be installed 6" maximum from adjacent walls.

Benches

The top of the bench seat surface shall be 17" minimum and 19" maximum above the floor. Surface of seat shall be slip resistant and not accumulate water. The bench shall be 42" long minimum and 20" to 24" deep.